

NFPA 50 Bulk Oxygen Systems at Consumer Sites 1985



NOTICE

All questions or other communications relating to this document should be sent only to NFPA Headquarters, addressed to the attention of the Committee responsible for the document.

For information on the procedures for requesting Technical Committees to issue Formal Interpretations, proposing Tentative Interim Amendments, proposing amendments for Committee consideration, and appeals on matters relating to the content of the document, write to the Secretary, Standards Council, National Fire Protection Association, Batterymarch Park, Quincy, MA 02269.

A statement, written or oral, that is not processed in accordance with Section 16 of the Regulations Governing Committee Projects shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

Users of this document should consult applicable Federal, State and local laws and regulations. NFPA does not, by the publication of this document, intend to urge action which is not in compliance with applicable laws and this document may not be construed as doing so.

Policy Adopted by NFPA Board of Directors on December 3, 1982

The Board of Directors reaffirms that the National Fire Protection Association recognizes that the toxicity of the products of combustion is an important factor in the loss of life from fire. NFPA has dealt with that subject in its technical committee documents for many years.

There is a concern that the growing use of synthetic materials may produce more or additional toxic products of combustion in a fire environment. The Board has, therefore, asked all NFPA technical committees to review the documents for which they are responsible to be sure that the documents respond to this current concern. To assist the committees in meeting this request, the Board has appointed an advisory committee to provide specific guidance to the technical committees on questions relating to assessing the hazards of the products of combustion.

Licensing Provision — This document is copyrighted by the National Fire Protection Association (NFPA).

1. Adoption by Reference — Public authorities and others are urged to reference this document in laws, ordinances, regulations, administrative orders or similar instruments. Any deletions, additions and changes desired by the adopting authority must be noted separately. Those using this method are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. The term "adoption by reference" means the citing of title and publishing information only.

2. Adoption by Transcription — **A.** Public authorities with lawmaking or rule-making powers only, upon written notice to the NFPA (Attention: Secretary, Standards Council), will be granted a royalty-free license to print and republish this document in whole or in part, with changes and additions, if any, noted separately, in laws, ordinances, regulations, administrative orders or similar instruments having the force of law, provided that: (1) due notice of NFPA's copyright is contained in each law and in each copy thereof; and, (2) that such printing and republication is limited to numbers sufficient to satisfy the jurisdiction's lawmaking or rulemaking process. **B.** Once this NFPA Code or Standard has been adopted into law, all printings of this document by public authorities with lawmaking or rulemaking powers or any other persons desiring to reproduce this document or its contents as adopted by the jurisdiction in whole or in part, in any form, upon written request to NFPA (Attention: Secretary, Standards Council), will be granted a nonexclusive license to print, republish, and vend this document in whole or in part, with changes and additions, if any, noted separately provided that due notice of NFPA's copyright is contained in each copy. Such license shall be granted only upon agreement to pay NFPA a royalty. This royalty is required to provide funds for the research and development necessary to continue the work of NFPA and its volunteers in continually updating and revising NFPA standards. Under certain circumstances, public authorities with lawmaking or rulemaking powers may apply for and may receive a special royalty when the public interest will be served thereby.

All other rights, including the right to vend, are retained by NFPA.

(For further explanation, see the Policy Concerning the Adoption, Printing and Publication of NFPA Documents which is available upon request from the NFPA.)

Statement on NFPA Procedures

This material has been developed under the published procedures of the National Fire Protection Association, which are designed to assure the appointment of technically competent Committees having balanced representation. While these procedures assure the highest degree of care, neither the National Fire Protection Association, its members, nor those participating in its activities accepts any liability resulting from compliance or noncompliance with the provisions given herein, for any restrictions imposed on materials or processes, or for the completeness of the text.

NFPA has no power or authority to police or enforce compliance with the contents of this document and any certification of products stating compliance with requirements of this document is made at the peril of the certifier.

© 1985 NFPA, All Rights Reserved

NFPA 50
Standard for
Bulk Oxygen Systems at Consumer Sites
1985 Edition

This edition of NFPA 50, *Standard for Bulk Oxygen Systems at Consumer Sites*, was prepared by the Technical Committee on Industrial and Medical Gases, and acted on by the National Fire Protection Association, Inc. at its Fall Meeting held November 12-15, 1984 in San Diego, California. It was issued by the Standards Council on December 7, 1984, with an effective date of December 27, 1984, and supersedes all previous editions.

The 1985 edition of this standard has been approved by the American National Standards Institute.

Changes other than editorial are indicated by a vertical rule in the margin of the pages on which they appear. These lines are included as an aid to the user in identifying changes from the previous edition.

Origin and Development of NFPA 50

Development of NFPA 50 was initiated by the Compressed Gas Association, Inc., who submitted a complete text to the NFPA Committee on Gases in 1955. Working responsibility for the project was assigned to the Sectional Committee on Industrial Gases and the standard was Tentatively Adopted in 1956. A revised edition was Officially Adopted in 1957 and subsequent revised editions were adopted in 1962 and 1965 as NFPA 566.

In June 1966 responsibility for NFPA 566 was reassigned to the Committee on Industrial and Medical Gases. With the 1971 edition, the standard was redesignated as NFPA 50.

Since the 1971 edition, revised editions were adopted in 1973, 1974, 1979 and 1985.

MORGAN TECHNICAL LIBRARY
NATIONAL FIRE PROTECTION ASSN.
BATTERY MARCH PARK
QUINCY, MA 02269

Committee on Industrial and Medical Gases

Fred K. Kitson, *Chairman*
F. K. Kitson Safety Associates

W. L. Walls, *Secretary*
National Fire Protection Association
(Nonvoting)

J. A. Cedervall, Underwriters Laboratories Inc.
Robert J. Falaguerra, Phelps Memorial Hospital
Rep. American Hospital Assn.
(Vote Limited to Medical Gases)
Leo G. Foxwell, Hartford Insurance Group
Rep. American Insurance Assn.
Charles B. Henrici, Elk Grove Village Fire Dept.
Rep. Intl. Assn. of Fire Chiefs
Bernard K. Kuehn, Compressed Gas Assn., Inc.

James A. Meyer, Pettis Memorial VA Hospital
Rep. American Society of Anesthesiologists
(Vote Limited to NFPA 56F)
William W. Russell, Monsanto Co.
Rep. Chemical Manufacturers Assn.
Henry C. Scuoteguazza, Factory Mutual
Research Corp.
Thomas S. Staron, Jr., Industrial Risk Insurers
A. A. Weintraub, US Dept. of Energy
Thomas E. Willoughby, Union Carbide Corp.
Rep. Compressed Gas Assn., Inc.

Alternates

William H. Barlen, Compressed Gas Assn., Inc.
(Alternate to B. K. Kuehn)
Robert I. Clift, Industrial Risk Insurers
(Alternate to T. S. Staron, Jr.)
Marvin E. Kennebeck, Jr., American Welding
Society (Vote Limited to NFPA 51)
(Alternate to American Welding Society Rep.)

David Eric Lees, Natl. Institutes of Health
(Alternate to J. A. Meyer)
Joseph G. Sprague, American Hospital Assn.
(Alternate to R. J. Falaguerra)

*This list represents the membership at the time the Committee was balloted on the text of this edition.
Since that time, changes in the membership may have occurred.*

NOTE: Membership on a Committee shall not in and of itself constitute an endorsement of the Association or any document developed by the Committee on which the member serves.

Contents

Chapter 1 General	50-4
1-1 Introduction	50-4
1-2 Application	50-4
1-3 Definitions	50-4
Chapter 2 Siting	50-5
2-1 Location of Bulk Oxygen Systems	50-5
2-2 Distance Between Bulk Oxygen Systems and Exposures	50-5
Chapter 3 System Fabrication	50-6
3-1 Bulk Oxygen Storage Containers	50-6
3-2 Piping, Tubing and Fittings	50-7
3-3 Safety Relief Devices	50-7
3-4 Liquid Oxygen Vaporizers	50-7
3-5 Equipment Assembly and Installation	50-7
Chapter 4 Operation and Maintenance	50-7
4-1 Operating Instructions	50-7
4-2 Maintenance	50-7
Chapter 5 Referenced Publications	50-8
Appendix A	50-8
Appendix B Referenced Publications	50-9

NFPA 50

Standard for

Bulk Oxygen Systems at Consumer Sites

1985 Edition

Chapter 1 General

NOTICE: An asterisk (*) following the number or letter designating a paragraph indicates explanatory material on that paragraph in Appendix A.

Information on referenced publications can be found in Chapter 5 and Appendix B.

1-1 Introduction.

1-1.1 Oxygen gas is colorless, odorless, tasteless and nontoxic. It comprises about 21 percent of normal air and is about 10 percent heavier than air. At atmospheric pressure and temperatures below -297°F (-182.5°C) oxygen is a liquid. Oxygen is stable in both gas and liquid phases. In the absence of moisture, oxygen in the gaseous or liquid form is noncorrosive.

1-1.2 Oxygen is nonflammable. Ignition of combustible materials may occur more readily in an oxygen-rich atmosphere than in air, and combustion proceeds at a faster rate although no more total heat is released. This standard therefore provides primarily for protection of the bulk oxygen system from involvement by fire from sources apart from the system itself. It is important to locate bulk oxygen systems in well-ventilated locations since oxygen-rich atmospheres may collect temporarily in confined areas in the event of functioning of a safety relief device or leakage from the system.

1-1.3* Oxygen system components, including, but not limited to, containers, valves, valve seats, lubricants, fittings, gaskets and interconnecting equipment including hoses, shall have adequate compatibility with oxygen under the conditions of temperature and pressure to which the components may be exposed in the containment and use of oxygen. Easily ignitable materials shall be avoided unless they are parts of equipment or systems that are approved, listed, or proved suitable by tests or by past experience.

1-2 Application.

1-2.1 This standard covers the general principles recommended for the installation of bulk oxygen systems on consumer premises where the supply to the consumer premises originates outside the consumer premises and is delivered by mobile equipment.

1-2.2 An existing system which is not in strict compliance with the provisions of this standard may be continued in use when such use does not constitute a distinct hazard to life or adjoining property.

1-2.3 This standard does not apply to oxygen manufacturing plants or other establishments operated by the oxygen supplier or his agent for the purpose of storing oxygen and refilling portable containers, trailers, mobile supply trucks or tank cars.

1-2.4 This standard does not apply to oxygen storage systems having capacities less than those stated in the definition of Bulk Oxygen System in Section 1-3 since those systems are covered by NFPA 51, *Standard for the Design and Installation of Oxygen-Fuel Gas Systems for Welding, Cutting, and Allied Processes*, and NFPA 56F, *Standard for Nonflammable Medical Gas Systems*.

1-2.5 When a bulk oxygen system is intended for medical gas applications, additional provisions are included in NFPA 56F, *Standard for Nonflammable Medical Gas Systems*.

1-3 Definitions. For the purpose of the standard, the following terms are defined:

Approved. Acceptable to the "authority having jurisdiction."

NOTE: The National Fire Protection Association does not approve, inspect or certify any installations, procedures, equipment, or materials nor does it approve or evaluate testing laboratories. In determining the acceptability of installations or procedures, equipment or materials, the authority having jurisdiction may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure or use. The authority having jurisdiction may also refer to the listings or labeling practices of an organization concerned with product evaluations which is in a position to determine compliance with appropriate standards for the current production of listed items.

Authority Having Jurisdiction. The "authority having jurisdiction" is the organization, office or individual responsible for "approving" equipment, an installation or a procedure.

NOTE: The phrase "authority having jurisdiction" is used in NFPA documents in a broad manner since jurisdictions and "approval" agencies vary as do their responsibilities. Where public safety is primary, the "authority having jurisdiction" may be a federal, state, local or other regional department or individual such as a fire chief, fire marshal, chief of a fire prevention bureau, labor department, health department, building official, electrical inspector, or others having statutory authority. For insurance purposes, an insurance inspection department, rating bureau, or other insurance company representative may be the "authority having jurisdiction." In many circumstances the property owner or his designated agent assumes the role of the "authority having jurisdiction"; at government installations, the commanding officer or departmental official may be the "authority having jurisdiction."

Bulk Oxygen System. A bulk oxygen system is an assembly of equipment, such as oxygen storage containers, pressure regulators, safety devices, vaporizers, manifolds, and interconnecting piping; which has a storage capacity of more than 20,000 cu ft (566 m³) of oxygen (NTP) including unconnected reserves on hand at the site. The bulk oxygen system terminates at the point where oxygen at service pressure first enters the supply line. The oxygen containers may be stationary or movable, and the oxygen may be stored as gas or liquid.

Chapter 2 Siting

Combustible Liquid. Combustible liquid shall mean a liquid having a closed cup flash point at or above 100°F (37.8°C) and shall be subdivided as follows: Class II liquids shall include those having a flash point at or above 100°F (37.8°C) and below 140°F (60°C). Class IIIA liquids shall include those having a flash point at or above 140°F (60°C) and below 200°F (93.4°C). Class IIIB liquids shall include those having flash points at or above 200°F (93.4°C).

Cubic Feet NTP. Cubic feet measured at normal atmospheric temperature and pressure.

Fire-Resistive Construction. A type of building construction as defined in NFPA 220, *Standard Types of Building Construction*.

Flammable Liquid. Flammable liquid Class I shall mean any liquid having a closed cup flash point below 100°F (37.8°C) and having a vapor pressure not exceeding 40 lb/sq in. absolute (276 kPa) at 100°F (37.8°C).

Gallon. A standard U.S. gallon.

Listed. Equipment or materials included in a list published by an organization acceptable to the "authority having jurisdiction" and concerned with product evaluation, that maintains periodic inspection of production of listed equipment or materials and whose listing states either that the equipment or material meets appropriate standards or has been tested and found suitable for use in a specified manner.

NOTE: The means for identifying listed equipment may vary for each organization concerned with product evaluation, some of which do not recognize equipment as listed unless it is also labeled. The "authority having jurisdiction" should utilize the system employed by the listing organization to identify a listed product.

Noncombustible/Limited-Combustible Construction. A type of building construction as defined in NFPA 220, *Standard on Types of Building Construction*.

Noncombustible Material (as defined in NFPA 220, *Standard on Types of Building Construction*). A material which, in the form in which it is used and under the conditions anticipated, will not ignite, burn, support combustion, or release flammable vapors when subjected to fire or heat. Materials reported as noncombustible, when tested in accordance with ASTM E-136, *Standard Method of Test for Behavior of Materials in a Vertical Tube Furnace at 750°C*, shall be considered noncombustible materials.

Shall. Indicates a mandatory requirement.

Should. Indicates a recommendation or that which is advised but not required.

Wood Frame Construction. A type of building construction as defined in NFPA 220, *Standard Types of Building Construction*.

2-1 Location of Bulk Oxygen Systems.

2-1.1 Bulk oxygen storage systems shall be located aboveground out of doors, or shall be installed in a building of fire-resistive or noncombustible/limited-combustible construction, adequately vented, and used for that purpose exclusively. The location selected shall be such that containers and associated equipment shall not be beneath or exposed by the failure of electric power lines, piping containing all classes of flammable or combustible liquids (*see Definitions*), or piping containing flammable gases.

2-1.2 The system shall be located so that it is readily accessible to mobile supply equipment at ground level and to authorized personnel. Bulk oxygen systems shall not be located on rooftops of buildings or other structures.

2-1.3 Where oxygen is stored as a liquid, surfacing of noncombustible material shall be provided at ground level under liquid delivery connections for the storage container and mobile supply equipment. This area shall be at least 3 ft (1 m) in diameter from points at ground level upon which leakage of liquid oxygen might fall during unloading and normal operation of the system. The area under the mobile supply equipment shall be at least the full width of the vehicle and at least 8 ft (2.5 m) in the direction of the vehicle axis. For purposes of this standard, asphaltic or bitumastic paving is considered to be combustible. The slope, if any, of such areas shall consider possible flow of spilled liquid oxygen to adjacent combustible material.

2-1.4* Where it is necessary to locate a bulk oxygen system on ground lower than all classes of adjacent flammable or combustible liquid storage, suitable means shall be taken (such as by diking, diversion curbs, or grading) with respect to the adjacent flammable or combustible liquid storage to prevent accumulation of liquids under the bulk oxygen system.

2-2* Distance Between Bulk Oxygen Systems and Exposures.

2-2.1 Except as provided in 2-2.1.14, the minimum distance from any bulk oxygen storage container to exposures, measured in the most direct line (except as indicated in 2-2.1.5 and 2-2.1.11), shall be as indicated in 2-2.1.1 to 2-2.1.14 inclusive.

2-2.1.1 50 ft (15 m) from buildings of wood frame construction.

2-2.1.2 Not less than 1 ft (0.3 m) (or other distance to permit system maintenance) from buildings of other than wood frame construction.

2-2.1.3 At least 10 ft (3 m) from any opening in walls of adjacent structures. This provision shall apply to all elements of a bulk oxygen system where the oxygen storage is high-pressure gas. Where the storage is as liquid, this provision shall apply to only pressure regulators, safety devices, vaporizers, manifolds, and interconnecting piping.

2-2.1.4 All Classes of Flammable and Combustible Liquid Storage Aboveground.

Distance (ft) (m)		Capacity (gal) (L)	
25*	(7.5)	1000 or less	(3785)
50*	(15)	1001 or more	(3789)

*May be reduced to 15 ft (4.6 m) for Class IIIB combustible liquids.

2-2.1.5 All Classes of Flammable and Combustible Liquid Storage Belowground.

Distance Measured Horizontally from Oxygen Storage Container to Tank (ft) (m)		Distance from Oxygen Storage Container to Filling and Vent Connections or Openings to Tank (ft) (m)	
15	(4.6)	25	(7.5)

2-2.1.6 Flammable Gases Aboveground.

Flammable Gas	Quantity	Distance (ft) (m)	
Liquefied Hydrogen*	Any	75	22.5
Other Liquefied Gases	1000 gal (3785 L) or less	25	7.5
	Over 1000 gal (3785 L)	50	15
Non-liquefied or Dissolved Gases	25,000 cu ft (708 m ³)(NTP) or less	25	7.5
	Over 25,000 cu ft (708 m ³)(NTP)	50	15

*See NFPA 50B, *Standard for Liquefied Hydrogen Systems at Consumer Sites*.

2-2.1.7 50 ft (15 m) from solid materials which burn rapidly, such as excelsior or paper.

2-2.1.8 25 ft (7.5 m) from solid materials which burn slowly, such as coal and heavy timber.

2-2.1.9 75 ft (22.5 m) in one direction and 35 ft (11 m) in approximately 90° direction from confining walls [not including protective structures having a minimum fire resistance rating of 2 hours less than 12 ft (3.7 m) high] to provide adequate ventilation in courtyards and similar confining areas.

2-2.1.10 50 ft (15 m) from places of public assembly.

2-2.1.11 50 ft (15 m) in a direct line from the inner container pressure relief device discharge piping outlets and filling and vent connections from areas occupied by nonambulatory patients.

2-2.1.12 10 ft (3 m) from any public sidewalk or parked vehicles.

2-2.1.13 5 ft (1.5 m) from any line of adjoining property which may be built upon.

2-2.1.14 The distances in 2-2.1.1, 2-2.1.4 to 2-2.1.8 inclusive, 2-2.1.12, and 2-2.1.13 do not apply where protective structures having a minimum fire resistance of 2 hours interrupt the line-of-sight between uninsulated portions of the bulk oxygen storage installation and the exposure. In such cases, the bulk oxygen installation shall be a minimum distance of 1 ft (0.3 m) (or greater distance if required for system maintenance) from the protective structure.

The protective structure (in lieu of distance) protects uninsulated oxygen storage containers or supports, control equipment enclosures, and system piping (or parts thereof) from external fire exposure. Liquid oxygen storage containers are insulated. Such containers can provide line-of-sight protection for uninsulated system components.

Protective structure configuration and dimensions will, therefore, vary depending upon the components of a particular system and their spatial relation to each other and to the exposure.

Chapter 3 System Fabrication

3-1 Bulk Oxygen Storage Containers.

3-1.1 Foundations and Supports. Permanently installed containers shall be provided with substantial supports of noncombustible material on firm foundations of noncombustible material.

3-1.2 Liquid oxygen containers shall comply with 3-1.2.1 or 3-1.2.2.

3-1.2.1 Be fabricated from materials meeting the impact test requirements of Paragraph UG-84 of the ASME *Boiler and Pressure Vessel Code*, Section VIII — Unfired Pressure Vessels. Containers operating at pressures above 15 psig (103 kPa) shall be designed, constructed and tested in accordance with appropriate requirements of the ASME *Boiler and Pressure Vessel Code*, Section VIII — Unfired Pressure Vessels. Insulation surrounding the liquid oxygen container shall be of noncombustible material.

3-1.2.2 Be designed, constructed, tested and maintained in accordance with U.S. Department of Transportation (DOT) Specifications and Regulations for 4L containers.

3-1.3 High-pressure gaseous oxygen containers shall comply with 3-1.3.1 or 3-1.3.2.

3-1.3.1 Be designed, constructed and tested in accordance with appropriate requirements of the ASME *Boiler and Pressure Vessel Code*, Section VIII — Unfired Pressure Vessels.

3-1.3.2 Be designed, constructed, tested and maintained in accordance with U.S. Department of Transportation (DOT) Specifications and Regulations.

3-2 Piping, Tubing and Fittings.

3-2.1 Piping, tubing and fittings shall be suitable for oxygen service and for the pressures and temperatures involved.

3-2.2 Material specifications and thickness requirements for piping and tubing shall conform to ANSI/ASME B31.3, *Code for Chemical Plant and Petroleum Refinery Piping*.

3-2.3* Piping or tubing for operating temperatures below -20°F (-28.9°C) shall be fabricated from materials meeting the impact test requirements of Chapter III of ANSI/ASME B31.3, *Code for Chemical Plant and Petroleum Refinery Piping*, when tested at the minimum operating temperature to which the piping may be subjected in service.

3-3 Safety Relief Devices.

3-3.1 Bulk oxygen storage containers, regardless of design pressure, shall be equipped with safety relief devices as required by the ASME Code or the DOT Specifications and Regulations. (See Section 3-1.)

3-3.2 Bulk oxygen storage containers designed and constructed in accordance with DOT Specifications (see 3-1.3.2) shall be equipped with safety relief devices as required by the DOT.

3-3.3 Bulk oxygen storage containers designed and constructed in accordance with the ASME *Boiler and Pressure Vessel Code*, Section VIII — Unfired Pressure Vessels, shall be equipped with safety relief devices meeting the provisions of CGA Publication S-1.3, *Safety Relief Device Standards for Compressed Gas Storage Containers*.

3-3.4 Insulation casing on liquid oxygen containers shall be equipped with suitable safety relief devices.

3-3.5 All safety relief devices shall be so designed or located that moisture cannot collect and freeze in a manner which would interfere with proper operation of the device.

3-4 Liquid Oxygen Vaporizers.

3-4.1 The vaporizer shall be anchored and its connecting piping be sufficiently flexible to provide for the effects of expansion and contraction due to temperature changes.

3-4.2 The vaporizer and its piping shall be adequately protected on the oxygen and heating medium sections with safety relief devices.

3-4.3 Heat used in an oxygen vaporizer shall be indirectly supplied only through mediums such as steam, air, water, or water solutions which do not react with oxygen.

3-4.4 If electric heaters are used to provide the primary source of heat, the vaporizing system shall be electrically grounded.

3-5 Equipment Assembly and Installation.

3-5.1 Equipment making up a bulk oxygen system shall be cleaned in order to remove oil, grease or other readily oxidizable materials before placing the system in service.

3-5.2 Joints in piping and tubing may be made by welding or brazing, or by use of flanged, threaded, socket, slip or compression fittings. Gaskets or thread sealants shall be suitable for oxygen service. Brazing materials shall have a melting point above 1000°F (538°C).

3-5.3 Valves, gages, regulators and other accessories shall be suitable for oxygen service.

3-5.4 Installation of bulk oxygen systems shall be supervised by personnel familiar with proper practices with reference to their construction and use.

3-5.5 After installation all field-erected piping shall be tested and proved gastight at maximum operating pressure. Any medium used for testing shall be oil-free and nonflammable.

3-5.6 Storage containers, piping, valves, regulating equipment, and other accessories shall be protected against physical damage and against tampering by the general public.

3-5.7 Any enclosure containing oxygen control or operating equipment shall be adequately vented.

3-5.8 The bulk oxygen storage location shall be permanently placarded to indicate: "OXYGEN — NO SMOKING — NO OPEN FLAMES," or an equivalent warning.

3-5.9 Bulk oxygen installations are not hazardous (classified) locations as defined and covered in Article 500 of NFPA 70, *National Electrical Code*®. Therefore, general purpose or weatherproof types of electrical wiring and equipment are acceptable depending upon whether the installation is indoors or outdoors. Such equipment shall be installed in accordance with the applicable provisions of NFPA 70, *National Electrical Code*.

Chapter 4 Operation and Maintenance

4-1 **Operating Instructions.** For installations which require any operation of equipment by the user, legible instructions shall be maintained at operating locations.

4-2 Maintenance.

4-2.1 Each bulk oxygen system installed on consumer premises shall be inspected annually and maintained by a qualified representative of the equipment owner.

4-2.2 Weeds and long dry grass shall be cut back within 15 ft (4.6 m) of any bulk oxygen storage container.

Chapter 5 Referenced Publications

5-1 The following documents or portions thereof are referenced within this standard and shall be considered part of the requirements of this document. The edition indicated for each reference is current as of the date of the NFPA issuance of this document. These references are listed separately to facilitate updating to the latest edition by the user.

5-1.1 **NFPA Publications.** National Fire Protection Association, Batterymarch Park, Quincy, MA 02269.

NFPA 70-1984, *National Electrical Code*.

NFPA 220-1979, *Standard Types of Building Construction*.

5-1.2 **ASME Publications.** American Society of Mechanical Engineers, 345 East 47th St., New York, NY 10017.

ANSI/ASME B31.3 (1980), *Code for Chemical Plant and Petroleum Refinery Piping*.

ASME Boiler and Pressure Vessel Code (1980).

5-1.3 **CGA Publication.** Compressed Gas Association, Inc., 1235 Jefferson Davis Highway, Arlington, VA 22202.

S-1.3, *Safety Relief Device Standards for Compressed Gas Storage Containers*.

5-1.4 **ASTM Publication.** American Society for Testing and Materials, 1916 Race Street, Philadelphia, PA 19103.

ASTM E-136-1981, *Standard Method of Test for Behavior of Materials in a Vertical Tube Furnace at 750°C*.

5-1.5 **U. S. Government Publication.** The following publication is available from the U. S. Government Printing Office, Washington, DC 20402.)

DOT Specifications and Regulations. Code of Federal Regulations. *Title 49, Transportation, Parts 171-190*. (Also available from the Association of American Railroads, American Railroads Bldg., 1920 L St. NW, Washington, DC 20036, and American Trucking Assn., Inc., 1916 P St. NW, Washington, DC 20036.)

Appendix A

This Appendix is not a part of the requirements of this NFPA document but is included for information purposes only.

The following notes, bearing the same number as the text of the *Standard for Bulk Oxygen Systems at Consumer Sites* to which they apply, contain useful explanatory material.

A-1-1.3 Compatibility involves both combustibility and ease of ignition. Materials that burn in air will burn violently in pure oxygen at normal pressure and explosively in pressurized oxygen. Also many materials that do not burn in air will do so in pure oxygen, particularly under pressure. Metals for containers and piping must be carefully selected, depending on service conditions. The various steels are acceptable for many applications, but some service conditions may call for other materials (usually copper or its alloys) because of their greater resistance to ignition and lower rate of combustion.

Similarly, materials that can be ignited in air have lower ignition energies in oxygen. Many such materials may be ignited by friction at a valve seat or stem packing or by adiabatic compression produced when oxygen at high pressure is rapidly introduced into a system initially at low pressure.

A-2-1.4 When locating bulk oxygen systems near all classes of aboveground flammable or combustible liquid storage which may be either indoors or outdoors, it is advisable to locate the system on ground higher than the flammable or combustible liquid storage.

A-2-2 The following diagram serves to illustrate the separation distances between bulk oxygen systems and exposures:

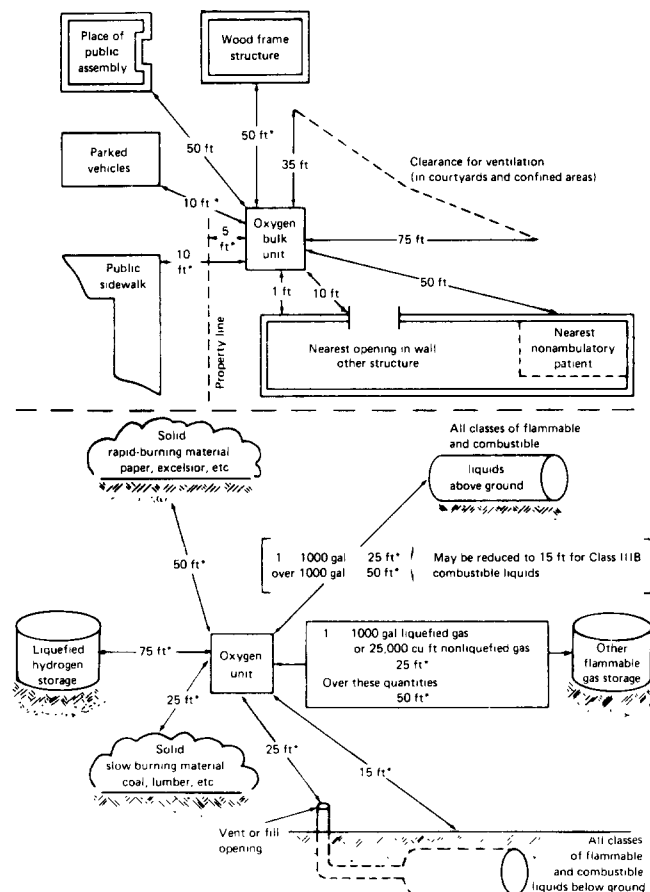


Illustration of Section 2-2, Distance Between Bulk Oxygen Systems and Exposures. (This diagram is not a part of NFPA 50 and the text shall govern.)

*NOTE: These distances do not apply where protective structures having a minimum fire resistance rating of 2 hours interrupt the line-of-sight between uninsulated portions of the bulk oxygen storage installation and the exposure. The protective structures protect uninsulated oxygen storage containers or supports, control equipment and system piping (or parts thereof) from external fire exposure. Liquid oxygen storage containers are insulated. Such containers may provide line-of-sight protection for uninsulated system components. (See 2-2.1.14.)

A-3-2.3 Some materials suitable for low-temperature piping are austenitic chromium-nickel alloy steels, copper, copper-silicon alloys, aluminum, and some brasses and bronzes.

Appendix B Referenced Publications

B-1 The following documents or portions thereof are referenced within this standard for informational purposes only and thus should not be considered part of the

requirements of this document. The edition indicated for each reference is current as of the date of the NFPA issuance of this document. These references are listed separately to facilitate updating to the latest edition by the user.

B-1.1 NFPA Publications. National Fire Protection Association, Batterymarch Park, Quincy, MA 02269.

NFPA 50B-1985, *Standard for Liquefied Hydrogen Systems at Consumer Sites*.

NFPA 51-1983, *Standard for the Design and Installation of Oxygen-Fuel Gas Systems for Welding, Cutting and Allied Processes*.

NFPA 56F-1983, *Standard for Nonflammable Medical Gas Systems*.